



BORDEN COUNTY WATER SYSTEM

WATER SYSTEM REGULATIONS

ADOPTED: MARCH 13, 2006

BORDEN COUNTY WATER SYSTEM

WATER SYSTEM REGULATION

TABLE OF CONTENTS

1) DEFINITIONS	1-2
2) TYPE OF WATER SERVICE.....	2
3) SERVICE AGREEMENT AND WATER METER DEPOSIT	2
4) BULK WATER STATION	2-3
5) METER INSTALLATION.....	3
6) WATER METER ACCESS.....	3-4
7) WATER RATES.....	4
8) PAYMENT FOR WATER USED	4
9) WATER LEAKS BEYOND THE METER.....	4-5
10) RETURNED CHECKS	5
11) WATER SERVICE CONNECTIONS OUTSIDE OF GAIL TOWNSITE	5
12) FLUORIDE CONTENT	5
13) INSTALLATIONS FOR PROVIDING LIVESTOCK WATER.....	5-6
TAPPING FEE AND WATER RATE CHARTS.....	7
SPECIFICATIONS FOR SERVICE LINES	8
PIPING AND FITTING SPECIFICATION.....	8
TRENCHING.....	8
REDUCED PRESSURE BACKFLOW ASSEMBLY AND REDUCED PRESSURE ZONE ASSEMBLY	8
NOTE	9
BLANK PAGE	10
ADOPTION AND SIGNATURE PAGE	11
BLANK PAGE	12
INSTALLATION INSTRUCTION FOR RPBA AND RPZA	13-14
RPBA AND RPZA INSTALLATION ILLUSTRATION	15

BORDEN COUNTY WATER SYSTEM

WATER SYSTEM REGULATIONS

1) DEFINITIONS

For the purposes of these Regulations, the following definitions shall apply:

Aesthetic water use: water use for ornamental or decorative purposes such as fountains, reflecting pools, and water gardens.

Agricultural water use: water use for the production of crops and livestock such as water to be used for the application of chemicals or supplemental water for animals.

Air gap: the unobstructed vertical distance through the free atmosphere between the lowest opening from any pipe or faucet conveying water to a tank, fixture, receptor, sink, or other assembly and the flood rim of the receptacle. The vertical, physical separation must be at least twice the diameter of the water supply outlet, but never less than one (1) inch.

Commercial and institutional water use: water use which is integral to the operations of commercial, non-profit establishments and non-governmental entities such as retail establishments, hotels and motels, restaurants, and office buildings.

Connection: a single family residential unit or each commercial or industrial establishment to which drinking water is supplied from the system.

Conservation: those practices, techniques, and technologies that reduce the consumption of water, reduce the loss or waste of water, improve the efficiency in the use of water or increase the recycling and reuse of water so that a supply is conserved and made available for future or alternative uses.

Cross-connection: a physical connection between a public water system and either another supply of unknown or questionable quality, any source which may contain contaminating or polluting substances, or any source of water treated to a lesser degree in the treatment process.

Customer: any person, company, or organization using water supplied by the Borden County Water System.

Domestic water use: water use for personal needs or for household or sanitary purposes such as drinking, bathing, heating, cooking, sanitation, or for cleaning a residence, business, industry, or institution.

Industrial water use: the use of water for purposes other than general consumption such as dust control, soil compaction, fire fighting and similar purposes.

Landscape irrigation use: water used for the irrigation and maintenance of landscape areas, whether publicly or privately owned, including residential and commercial lawns, gardens, golf courses, parks, right-of-ways and medians.

Public water system: a system for the provision to the public of water for human consumption through pipes or other constructed conveyances, which includes all uses described under the definition for drinking water. Such a system must have at least fifteen (15) service connections or serve at least twenty-five (25) individuals at least sixty (60) days out of the year. Without excluding other meanings of the terms "individual" or "served", an individual shall be deemed to be served by a water system if he lives in, uses as his place of employment, or works in a place to which drinking water is supplied from the system.

Office. A copy of this agreement will be available to the customer. There shall be no debt owed to Borden County by the individual submitting the request.

- b) A fee of \$15.00 shall be accessed for each account created. A fee of \$5.00 shall be accessed for a replacement ID card. Upon termination of the account, all customer account information will be removed from the system database.

5) METER INSTALLATION

- a) New Service Installation – A tapping fee shall be charged for each new service installation according to the size of the meter tap. A site survey shall be conducted prior to installation and applicable fees will be calculated at that time. Chart #1 (see page 7) shall be used to calculate these fees.
- b) Refundable account deposits shall be required for new installations and re-connect of water meters.
 - Residential deposit \$50.00
 - Commercial deposit \$100.00
- c) Re-connect of water meter – A fee shall be charged for a re-connect of a water meter where a water meter connection currently exists.
 - Residential \$100.00
 - Commercial \$100.00
- d) Water service shall be offered to all consumers within the original townsite of Gail. All water piping shall be installed in the streets and alleys to the nearest deeded property line of the consumer.
- e) Water service to unknown lots, where there are no deeds, leases, or proof of title in the consumer's name, shall have water meters connected to existing water service mains only. The consumer, at his/her expense, shall install water lines from existing water mains using streets and alleys as designated by the Commissioner's Court. All piping and trenching must meet the specifications set by the Commissioner's Court. These specifications are listed on page 8 and 9 of these regulations.
- f) If the installation is for a mobile home unit, this unit must be in place before water service will be installed.
- g) If the installation is for a permanent structure, the foundation must be started before water service will be installed.
- h) If the installation is for commercial use, foundation must be started before water service will be installed.

6) WATER METER ACCESS

- a) Water meters must remain clear of any barriers or dangerous animals(s) to allow Borden County employees and/or agents to have access to the water meters for maintenance and the monthly recording of water usage.
- b) When a Borden County employee and/or agent is denied access to a water meter by a barrier or dangerous animal(s) on or around the water meter, the customer will be notified by mail, and the customer must permanently remove the barrier or dangerous animal(s) within ten (10) days. If the barrier is not removed within the time period allowed, the water usage for that month shall be set at the previous month's usage plus fifty percent (50%).

- b) There shall be a \$20.00 fee for testing of a water meter when requested by the customer. This fee shall be waived if the water meter is proven to be faulty.

10) RETURNED CHECKS

- a) There shall be a service charge of \$25.00 for each returned check.

11) WATER SERVICE CONNECTIONS OUTSIDE OF GAIL TOWNSITE.

- a) A water meter tap may be provided only if water is available. The Commissioner's Court or their designee shall consider each request for a water meter tap on a per case basis.
- b) If water service is approved, the customer shall, at his or her, own expense, provide pipe, ditching and all labor for this installation. All piping shall meet specifications set by the Commissioner's Court.
- c) Water service connections, and water rates, on the transmission line west of Everett Tank to the water wells shall be according to individual contracts.
- d) Water service connections on the transmission line east of the Everett Tank to the west boundary of Gail shall be considered on an individual case basis. Water rates shall be according to Chart #2, Ranch Rates (see page 7).

12) FLUORIDE CONTENT

- a) Drinking water from the Borden County Water System exceeds the standards for fluoride content.
- b) To comply with TCEQ regulations bottled water shall be furnished to households that are connected to the Borden County Water System with children under fourteen (14) years of age. Bottled water may be purchased by the customer at the rate of fifteen (15) gallons per child per month. The Borden County Water System shall reimburse the customer when receipts are surrendered to the County Treasurer.

13) INSTALLATIONS FOR PROVIDING LIVESTOCK WATER

- a) All installations used for livestock purposes shall be metered. New installations shall be inspected and documented by water department personnel before a water meter is installed. Existing installations shall be subject to random inspections by water department personnel.
- b) Vessels used for livestock watering shall be water tight and constructed of concrete, steel, plastic, fiberglass, or other approved material. Vessels or plumbing material used for any purpose other than water storage or supply is strictly prohibited.
- c) An air gap of six (6) inches or more must be provided at each installation. Any installation that fails to maintain the air gap requirement shall be in violation of TCEQ rules and shall be taken out of service immediately by water department personnel. Water service shall be continued when the violation is corrected. Water department personnel shall inspect and document corrections made to the installation.
- d) Any leakage or overflow of water from the vessel should be repaired or corrected to water department satisfaction as soon as possible by the owner. Any leakage or overflow from a vessel shall be documented by water department personnel and the owner shall be notified. A notice shall be issued after ten (10) days if the cause of the leakage or overflow is not corrected. If it is not corrected within thirty (30) days water service shall be terminated. A re-connect fee of \$150.00 shall be paid before water service is re-instated.

TAPPING FEE AND WATER RATE CHARTS

CHART #1 - TAPPING RATES AND ASSOCIATED FEES

Tapping Rates	
3/4" meter	\$500.00
1" meter	\$600.00
1-1/2" meter	\$850.00
2" meter	Actual Cost
3" meter	Actual Cost
4" meter	Actual Cost
Associated Fees	
Pavement Cut	\$250.00
Connect Fee-Residential	\$100.00
Connect Fee-Commercial	\$150.00

CHART #2 – WATER RATES

Residential and Commercial Service:

3/4" meter	\$38.25 with 2,000 gallons
3/4" meter, Senior/Church	\$22.50 with 2,000 gallons
1" meter	\$42.25 with 2,000 gallons
1-1/2" meter	\$60.00 with 2,000 gallons
2" meter	\$65.00 with 2,000 gallons
3" – 4" meter	\$175.00 with 2,000 gallons

Water Use Rates:

2,001 – 5,000 gallons	\$6.00 per thousand
5,001 – 10,000 gallons	\$6.50 per thousand
10,001 +	\$7.00 per thousand

Ranch Rates:

3/4" meter	\$38.25 with 2,000 gallons
2,001 +	\$9.00 per thousand

CHART #3 - BULK WATER STATION RATES

Residential:	\$7.00 per thousand
Agriculture	\$7.00 per thousand
Commercial/Industrial	\$7.00 per thousand

NOTE: For installations that require a reduced pressure backflow device to be installed, refer to the document titled ***“Installation Instructions for Reduced Pressure Backflow Assembly (RPBA) and Reduced Pressure Zone Assembly (RPZA)”***. This document lists the requirements necessary to install these devices and the procedure for proper testing. It will be provided to the consumer upon determination that a backflow device is required. It is available in the County Judge’s Office upon request.

THESE REGULATIONS WERE ORIGINALLY ADOPTED ON FEBRUARY 1, 2006.

REVISIONS ADOPTED ON THIS 12TH DAY OF MARCH, 2012.

REVISIONS ADOPTED ON THIS 8TH DAY OF MAY, 2012.

REVISIONS ADOPTED ON THIS 22ND DAY OF JULY, 2014

REVISIONS ADOPTED ON THIS 3RD DAY OF JANUARY, 2018

REVISIONS ADOPTED ON THIS 14TH DAY OF JANUARY, 2020



Ross D. Sharp
County Judge

ATTEST:





Jana Underwood
County Clerk

BORDEN COUNTY WATER SYSTEM

INSTALLATION INSTRUCTIONS FOR REDUCED PRESSURE BACKFLOW ASSEMBLY (RPBA) AND REDUCED PRESSURE ZONE ASSEMBLY (RPZA).

All backflow prevention devices must be installed in accordance with the manufacturer's installation instructions and the following Borden County Water System specifications.

- Pipelines shall be thoroughly flushed to remove foreign material and debris before installing the backflow device.
- Commercial installation shall be considered on a per case basis.
- Residential installation is on side of building or house. (recommended)
- The backflow prevention device assembly shall include two (2) shut off valves in full compliance of the device manufacturer and supplied with the backflow device. The inlet valve shall have a test port (cock) on the upstream side of the valve.
- The backflow device shall be placed in a horizontal position unless otherwise specified by the manufacturer's instructions. The device must be protected from freezing temperatures.
- The backflow device shall be installed in an accessible location to facilitate testing and servicing. Installation shall be either on the master water meter assembly downstream just after the water meter or near the property line when a meter is not used. When conditions will not allow a backflow device to be installed as designated in the rule, a request for waiver of the rule may be submitted to the County Judge's Office. The request must be submitted in writing by the consumer and will be considered on a per case basis by the County Judge and the water system Operator. Water meter pipe size normally dictates the backflow device size. Head loss and volume requirements should be determined prior to installation; see manufacturer's head loss curve for more information.
- Parallel backflow devices may be necessary if water shut down during testing is not practical.
- The backflow device shall be installed with a minimum of 12" (inches) clearance between the relief valve opening and ground level. A 3" (inch) drain to daylight shall be provided at ground level in order to prevent any part of the device from becoming submerged. A screen with ¼" maximum openings shall be installed on the outside of the drain to daylight. The area under the backflow device shall have a minimum of 4" (inches) of drainage rock to prevent pooling during testing. See page 3 for illustrations.
- Backflow devices installed in modified enclosures shall have at least 12" (inches) of clearance on each side of the device to facilitate testing and servicing.
- Never plug or solidly pipe the relief valve into a drainage ditch, sewer pipe or pump. The relief valve discharge opening shall terminate at a minimum of 12" (inches) above ground level so that it is clearly visible and accessible. The device shall be adequately supported to prevent the assembly from sagging.
- The backflow device test ports (cocks) shall be threaded and plugged, and not used for any other purpose except testing, as is the intent of the manufacturer.
- The backflow device shall meet the requirements of ASSE standard 1013 and AWWA standard C511.
- A strainer is recommended and may be installed ahead of the device to extend service life by preventing fouling from debris.

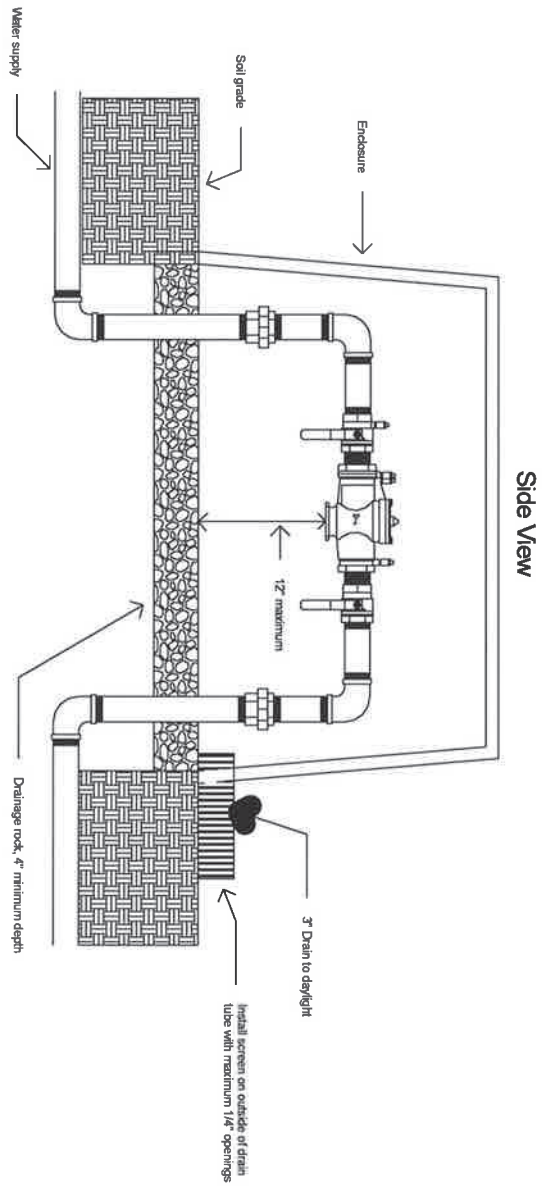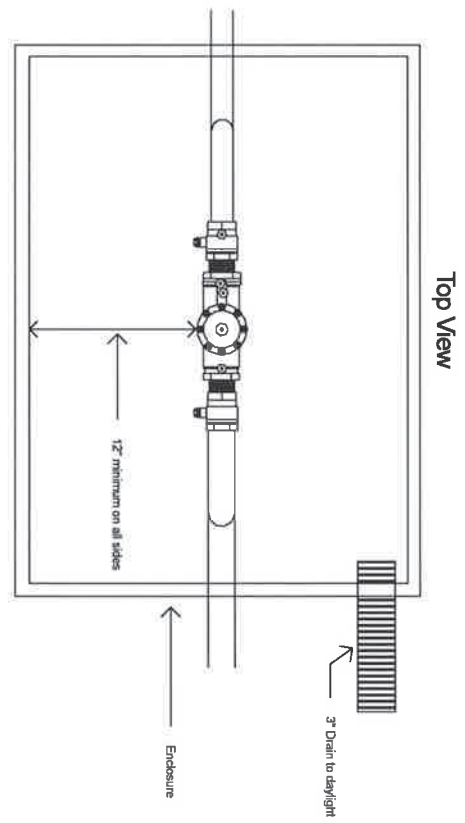

Typical RPBA and RPZA Installation Illustration